

ASME B16.51-2021
(Revision of ASME B16.51-2018)

Copper and Copper Alloy Press-Connect Pressure Fittings

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

ASME B16.51-2021
(Revision of ASME B16.51-2018)

Copper and Copper Alloy Press-Connect Pressure Fittings

AN AMERICAN NATIONAL STANDARD



**The American Society of
Mechanical Engineers**

Two Park Avenue • New York, NY • 10016 USA

Date of Issuance: February 28, 2022

The next edition of this Standard is scheduled for publication in 2026.

ASME issues written replies to inquiries concerning interpretations of technical aspects of this Standard. Periodically certain actions of the ASME B16 Committee may be published as Cases. Cases and interpretations are published on the ASME website under the Committee Pages at <http://cstools.asme.org/> as they are issued.

Errata to codes and standards may be posted on the ASME website under the Committee Pages to provide corrections to incorrectly published items, or to correct typographical or grammatical errors in codes and standards. Such errata shall be used on the date posted.

The Committee Pages can be found at <http://cstools.asme.org/>. There is an option available to automatically receive an e-mail notification when errata are posted to a particular code or standard. This option can be found on the appropriate Committee Page after selecting "Errata" in the "Publication Information" section.

ASME is the registered trademark of The American Society of Mechanical Engineers.

This code or standard was developed under procedures accredited as meeting the criteria for American National Standards. The Standards Committee that approved the code or standard was balanced to assure that individuals from competent and concerned interests have had an opportunity to participate. The proposed code or standard was made available for public review and comment that provides an opportunity for additional public input from industry, academia, regulatory agencies, and the public-at-large.

ASME does not "approve," "rate," or "endorse" any item, construction, proprietary device, or activity.

ASME does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a standard against liability for infringement of any applicable letters patent, nor assume any such liability. Users of a code or standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this code or standard.

ASME accepts responsibility for only those interpretations of this document issued in accordance with the established ASME procedures and policies, which precludes the issuance of interpretations by individuals.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

The American Society of Mechanical Engineers
Two Park Avenue, New York, NY 10016-5990

Copyright © 2022 by
THE AMERICAN SOCIETY OF MECHANICAL ENGINEERS
All rights reserved

CONTENTS

Foreword	v
Committee Roster	vi
Correspondence With the B16 Committee	vii
Summary of Changes	ix
List of Changes in Record Number Order	x
1 Scope	1
2 General	1
3 Terminology	1
4 Size	2
5 Marking	2
6 Material	2
7 Laying Lengths	2
8 Tube Stops	2
9 Design	3
10 Threaded Ends	3
11 Alignment	3
12 Gaging	3
13 Installation Instructions	4
14 Design Qualification	4
Mandatory Appendix	
I References	15
Nonmandatory Appendix	
A Quality System Program	16
Figures	
3.1-1 Method of Designating Laying Lengths of Fittings and Openings of Reducing Fittings	6
8-1 Tube Stops	10
11-1 Alignment	10
14.2.1-1 Test Setup for Pressure Test	10
14.4.1-1 Test Setup for Static Torque Test	11
14.5.1-1 Test Setup for Bending Test	12
14.8.1-1 Test Setup for Vibration Test	13
14.9.1-1 Test Setup for Thermocycling Test	14
14.10.1-1 Test Setup for Dynamic Torque Test	14

Tables

9.1-1	Dimensions of Press-Connect Ends	8
14.2.2-1	Maximum Slippage	11
14.4.1-1	Torque	11
14.5.1-1	Concentrated Load	12

FOREWORD

Standardization of cast and wrought press-connect pressure fittings was initiated by Subcommittee J of the ASME B16 Committee in 2000. The first draft of the Standard was based on International Association of Plumbing and Mechanical Officials (IAPMO) Interim Guide Criteria IGC 137-2000. The general requirements of ASME B16.22-2000 and ASME B16.24-1998 were added to the first draft. The development of the Standard was necessary to regulate the strength of the joint in copper press-connect fittings. The performance test requirements of this Standard are an important aspect for determining the quality of the fittings.

Following approval by the Standards Committee and the ASME Board on PTCS, approval as an American National Standard was given by the American National Standards Institute (ANSI) on December 21, 2011 with the designation ASME B16.51-2011.

In the 2013 edition, provisions were included to recognize low-lead alloys to comply with an amendment to the U.S. Safe Drinking Water Act that went into effect in January 2014. Following approval by the ASME B16 Standards Committee, approval as an American National Standard was given by ANSI on July 29, 2013 with the designation ASME B16.51-2013.

In the 2018 edition, the acceptance criteria for the maximum slippage of the fitting during hydrostatic testing was revised for the $\frac{3}{4}$ -in. nominal size to reflect the appropriate correlation to tube diameter used for all other fitting sizes. Also, in response to an inquiry on the test requirements for the elastomeric sealing components, para. 6.3 was revised to change the durometer values from a nominal value with tolerances to an absolute minimum value of 55 points on the Shore A scale. In addition, tolerances were added to all of the dimensional requirements shown in the figures throughout the Standard. The U.S. Customary tables formerly in Mandatory Appendix I were merged with the SI tables in the main text; the tables and figures were redesignated, Mandatory Appendix I was deleted, and the cross-references were updated accordingly. In addition, all reference standards in what was formerly Mandatory Appendix II were updated. Following approval by the ASME B16 Standards Committee, ASME B16.51-2018 was approved by ANSI on September 6, 2018.

In this 2021 edition, paras. 3.2, 6.1, and 6.3 have been revised and the references in Mandatory Appendix I have been updated. Following approval by the ASME B16 Standards Committee, ASME B16.21-2021 was approved by ANSI on November 12, 2021.

ASME B16 COMMITTEE

Standardization of Valves, Flanges, Fittings, and Gaskets

(The following is the roster of the Committee at the time of approval of this Standard.)

STANDARDS COMMITTEE OFFICERS

C. E. Davila, *Chair*
R. M. Bojarczuk, *Vice Chair*
S. J. Rossi, *Secretary*

STANDARDS COMMITTEE PERSONNEL

A. Appleton , Alloy Stainless Products Co., Inc.	T. A. McMahon , Emerson Automation Solutions
J. E. Barker , DeZURIK, Inc.	R. C. Merrick , Consultant
R. W. Barnes , ANRIC Enterprises, Inc.	W. H. Patrick , Dow Chemical Co.
D. C. Bayreuther , Neles Corp.	D. W. Raho , CCM 2000
W. B. Bedesem , Consultant	D. F. Reid , VSP Technologies
R. M. Bojarczuk , Retired	S. J. Rossi , The American Society of Mechanical Engineers
A. M. Cheta , Shell Global Solutions (U.S.)	R. A. Schmidt , Canadoil
M. A. Clark , NIBCO, Inc.	J. Sekerak , CSA Group
G. A. Cuccio , Capitol Manufacturing Co.	F. R. Volgstadt , Volgstadt and Associates, Inc.
C. E. Davila , Crane Chempharma and Energy	F. Feng , <i>Delegate</i> , China Productivity Center for Machinery
K. S. Felder , Valero Energy	J. D. Grant , <i>Alternate</i> , DeZURIK, Inc.
D. R. Frikken , Becht Engineering Co., Inc.	P. V. Craig , <i>Contributing Member</i> , Jomar Group
J. R. Holstrom , Val-Matic Valve and Manufacturing Corp.	B. G. Fabian , <i>Contributing Member</i> , Pennsylvania Machine Works
D. Hunt, Jr. , Fastenal	A. G. Kireta, Jr. , <i>Contributing Member</i> , Copper Development Association, Inc.
G. A. Jolly , Samshin, Ltd.	
E. J. Lain , Exelon Nuclear	

SUBCOMMITTEE J — COPPER AND COPPER ALLOY FLANGES, FLANGED FITTINGS, AND SOLDER-JOINT FITTINGS

A. G. Kireta, Jr. , <i>Chair</i> , Copper Development Association, Inc.	D. Hunt, Jr. , Fastenal
W. E. Chapin , <i>Vice Chair</i> , Professional Code Consulting, LLC	R. Kelsey , NIBCO, Inc.
R. R. Rahaman , <i>Secretary</i> , The American Society of Mechanical Engineers	C. A. Mueller , Mueller Streamline Co.
J. A. Ballanco , JB Engineering and Code Consulting, PC	F. Shingleton , Viega, LLC
D. R. Frikken , Becht Engineering Co., Inc.	J. C. Gast , <i>Alternate</i> , Mueller Fittings
	J. Atkinson , <i>Contributing Member</i> , Consultant

CORRESPONDENCE WITH THE B16 COMMITTEE

General. ASME Standards are developed and maintained with the intent to represent the consensus of concerned interests. As such, users of this Standard may interact with the Committee by requesting interpretations, proposing revisions or a case, and attending Committee meetings. Correspondence should be addressed to:

Secretary, B16 Standards Committee
The American Society of Mechanical Engineers
Two Park Avenue
New York, NY 10016-5990
<http://go.asme.org/Inquiry>

Proposing Revisions. Revisions are made periodically to the Standard to incorporate changes that appear necessary or desirable, as demonstrated by the experience gained from the application of the Standard. Approved revisions will be published periodically.

The Committee welcomes proposals for revisions to this Standard. Such proposals should be as specific as possible, citing the paragraph number(s), the proposed wording, and a detailed description of the reasons for the proposal, including any pertinent documentation.

Proposing a Case. Cases may be issued to provide alternative rules when justified, to permit early implementation of an approved revision when the need is urgent, or to provide rules not covered by existing provisions. Cases are effective immediately upon ASME approval and shall be posted on the ASME Committee web page.

Requests for Cases shall provide a Statement of Need and Background Information. The request should identify the Standard and the paragraph, figure, or table number(s), and be written as a Question and Reply in the same format as existing Cases. Requests for Cases should also indicate the applicable edition(s) of the Standard to which the proposed Case applies.

Interpretations. Upon request, the B16 Standards Committee will render an interpretation of any requirement of the Standard. Interpretations can only be rendered in response to a written request sent to the Secretary of the B16 Standards Committee.

Requests for interpretation should preferably be submitted through the online Interpretation Submittal Form. The form is accessible at <http://go.asme.org/InterpretationRequest>. Upon submittal of the form, the Inquirer will receive an automatic e-mail confirming receipt.

If the Inquirer is unable to use the online form, he/she may e-mail the request to the Secretary of the B16 Standards Committee at SecretaryB16@asme.org, or mail it to the above address. The request for an interpretation should be clear and unambiguous. It is further recommended that the Inquirer submit his/her request in the following format:

Subject:	Cite the applicable paragraph number(s) and the topic of the inquiry in one or two words.
Edition:	Cite the applicable edition of the Standard for which the interpretation is being requested.
Question:	Phrase the question as a request for an interpretation of a specific requirement suitable for general understanding and use, not as a request for an approval of a proprietary design or situation. Please provide a condensed and precise question, composed in such a way that a “yes” or “no” reply is acceptable.
Proposed Reply(ies):	Provide a proposed reply(ies) in the form of “Yes” or “No,” with explanation as needed. If entering replies to more than one question, please number the questions and replies.
Background Information:	Provide the Committee with any background information that will assist the Committee in understanding the inquiry. The Inquirer may also include any plans or drawings that are necessary to explain the question; however, they should not contain proprietary names or information.

Requests that are not in the format described above may be rewritten in the appropriate format by the Committee prior to being answered, which may inadvertently change the intent of the original request.

Moreover, ASME does not act as a consultant for specific engineering problems or for the general application or understanding of the Standard requirements. If, based on the inquiry information submitted, it is the opinion of the Committee that the Inquirer should seek assistance, the inquiry will be returned with the recommendation that such assistance be obtained.

ASME procedures provide for reconsideration of any interpretation when or if additional information that might affect an interpretation is available. Further, persons aggrieved by an interpretation may appeal to the cognizant ASME Committee or Subcommittee. ASME does not “approve,” “certify,” “rate,” or “endorse” any item, construction, proprietary device, or activity.

Attending Committee Meetings. The B16 Standards Committee regularly holds meetings and/or telephone conferences that are open to the public. Persons wishing to attend any meeting and/or telephone conference should contact the Secretary of the B16 Standards Committee.

ASME B16.51-2021

SUMMARY OF CHANGES

Following approval by the ASME B16 Standards Committee and ASME, and after public review, ASME B16.51-2021 was approved by the American National Standards Institute on November 12, 2021.

ASME B16.51-2021 includes the following changes identified by a margin note, **(21)**. The Record Numbers listed below are explained in more detail in the "List of Changes in Record Number Order" following this Summary of Changes.

<i>Page</i>	<i>Location</i>	<i>Change (Record Number)</i>
1	3.2	(1) First sentence editorially revised (2) Definition of <i>wrought</i> added (18-106)
2	6.1	In subpara. (b), first sentence revised (18-106)
2	6.3	Subparagraph (b) revised (18-1388)
15	Mandatory Appendix I	References updated (20-300)

LIST OF CHANGES IN RECORD NUMBER ORDER

<u>Record Number</u>	<u>Change</u>
18-106	Added definition of <i>wrought</i> in para. 3.2, and revised the material requirements in para. 6.1(b) to allow the use of a forged, lead-free, copper alloy.
18-1388	Revised the special requirements (Z2) for compression set testing on elastomers (seals) in para. 6.3(b).
20-300	Updated references in Mandatory Appendix I.

COPPER AND COPPER ALLOY PRESS-CONNECT PRESSURE FITTINGS

1 SCOPE

This Standard establishes requirements for cast copper alloy, wrought copper, and wrought copper alloy press-connect pressure fittings for use with hard-drawn seamless copper water tube conforming to ASTM B88 for piping systems conveying water. The press-connect system (tube, fitting, and joint) conforming to this Standard is for use at a maximum pressure of 1 380 kPa (200 psi) over the temperature range from 0°C to 93°C (32°F to 200°F).

This Standard provides requirements for fittings suitable for press-connect joining and covers the following:

- (a) terminology
- (b) size designations
- (c) marking
- (d) material
- (e) dimensions and tolerances
- (f) required installation instructions
- (g) pressure-temperature ratings
- (h) design qualification

2 GENERAL

2.1 Convention

For determining conformance with this Standard, the convention for fixing significant digits where limits (maximum and minimum values) are specified shall be as defined in ASTM E29. This requires that an observed or calculated value be rounded off to the nearest unit in the last right-hand digit used for expressing the limit. Decimal values and tolerances do not imply a particular method of measurement.

2.2 Relevant Units

This Standard states values in both SI (metric) and U.S. Customary units. These systems of units are to be regarded separately as standard. In this Standard, the U.S. Customary units are shown in parentheses. The values stated in each system are not exact equivalents; therefore, it is required that each system of units be used independently of the other. Combining values from the two systems constitutes nonconformance with the Standard.

2.3 References

Codes, standards, and specifications containing provisions to the extent referenced herein constitute requirements of this Standard. These referenced documents are listed in [Mandatory Appendix I](#).

2.4 Quality Systems

Requirements relating to the product manufacturer's Quality System Program are described in [Nonmandatory Appendix A](#).

3 TERMINOLOGY

3.1 Abbreviations

The following abbreviations are used to designate the type of fitting end as shown in [Figure 3.1-1](#):

F = internal ASME B1.20.1 taper pipe-thread end (NPTI)

FTG = solder-joint fitting end made to copper tube outside diameter

M = external ASME B1.20.1 taper pipe-thread end (NPTE)

P = internal press-connect joint end made to receive copper tube diameter

3.2 Definitions

(21)

The following defines the terms used in this Standard:
joining, press-connect: the act of joining a fitting or piping component to a tube by use of a tool that mechanically compresses the wall of the fitting end over the tubing, encasing an elastomeric seal between the mating surfaces.

out-of-roundness: the maximum measured diameter minus the minimum measured diameter.

press-connect fitting: a type of piping component (e.g., coupling, tee, elbow) used to connect tubing or other accessories by mechanically compressing the wall of the fitting end over the tube, using an elastomeric material to provide a seal between the inside surface of the fitting and the outside surface of the tube.

wrought: describing metal that is worked in solid form to form shapes or individual parts including but not limited to tubular shapes, bars, and forgings.

4 SIZE

The size designations of the fittings shown in the tables of this Standard correspond to standard water tube sizes as shown in ASTM B88. The size designations of the threaded ends correspond to nominal pipe sizes as shown in ASME B1.20.1.

Fittings shall be designated by the size of the openings in the sequence illustrated in Figure 3.1-1.

5 MARKING

Each fitting shall be permanently marked with the manufacturer's name or trademark in accordance with ANSI MSS SP-25. Marking on fittings less than nominal size $\frac{1}{2}$ or on any fitting where it damages joining surfaces is not required.

6 MATERIAL

(21) 6.1 Wrought Copper Alloys

(a) Fittings shall be made from copper alloy UNS No. C10200, C12000, C12200, or C23000.

(b) Other coppers and copper alloys shall be permitted, provided their chemical composition contains a minimum of 80% copper and a maximum of 16% zinc, and provided the fittings produced from the copper alloy meet all the mechanical and corrosion-resistant properties for the end purposes of the fittings. For potable water applications, fittings shall be produced from low-lead (0.25% or less) copper alloys and shall meet all the mechanical and corrosion-resistant properties for the end purposes of the fittings. The composition of the copper alloy shall not inhibit joining to the tube or to other fittings.

6.2 Cast Copper Alloys

(a) Castings intended for use in applications up to 204°C (400°F) shall be of a copper alloy produced to meet

(1) the requirements of ASTM B62 UNS No. C83600, or

(2) the chemical and tensile requirements of ASTM B584 UNS No. C83800 or C84400 and in all other respects the requirements of ASTM B62

(b) Castings intended for use in potable water applications up to 93°C (200°F) shall be low lead (0.25% or less) and shall be

(1) of a copper alloy produced to meet the requirements of ASTM B584 UNS No. C87850 or C89833, or

(2) of other cast copper alloys, provided the fittings produced meet mechanical and corrosion-resistant properties needed for potable water application

(21) 6.3 Elastomers (Seals)

Elastomeric components shall be resistant to microbiological attack and ozone attack and shall contain inhibitors to prevent copper degradation. The elastomer shall be an

ethylene propylene diene monomer (EPDM) and shall meet the minimum property and test requirements as defined by ASTM D2000, shown in the following table:

Material	EPDM
Minimum durometer hardness, Shore A	55 points
Minimum tensile strength, MPa (psi)	10 (1,450)
Heat resistance	A25
Compression set	B35
Water resistance	EA14
Low-temperature resistance	F17
Tear resistance	G21
Special requirements	Z1, Z2, Z3, Z4

The special requirements shall be as follows:

(a) Z1 designates compliance with NSF/ANSI 61.

(b) Z2 designates the compression set. Elastomeric material shall be tested for compression set as per the ASTM D2000 suffix requirements of B35 in accordance with ASTM D395, Method B, plied, for 22 h at 125°C. The maximum allowed compression set shall be 30%.

(c) Z3 designates chloramine resistance, which is determined by testing for 1 008 h at 70°C (158°F) in a solution containing 50 ppm total chlorine, per ASTM D6284; this shall be checked and refreshed daily. Upon completion of the test, the change in volume shall be less than 30%, and the change in durometer hardness shall be a maximum of 6. There shall be no visual degradation of the elastomeric material.

(d) Z4 designates resistance of the elastomer to copper degradation. The test shall be conducted in accordance with para. 14.9.1. Upon completion of the test, the change in volume shall be less than 30%, and the change in durometer hardness shall be a maximum of 6. There shall be no visual degradation of the elastomeric material.

6.4 Seal Lubricant

The only seal lubricant that shall be used is that specified by the manufacturer.

7 LAYING LENGTHS

Due to widely varying manufacturing processes, meaningful laying length requirements of fittings cannot be established. Consult the manufacturer for these dimensions.

8 TUBE STOPS

Except for repair couplings, fittings shall be manufactured with a tube stop (abutment) to limit tube insertion. Repair couplings shall not require a tube stop. The tube stop shall control joint length, even with an external (FTG) end having the minimum outside diameter shown in

Table 9.1-1. Examples of various tube stop configurations are shown in Figure 8-1.

9 DESIGN

9.1 General

As a minimum, the fitting shall be designed to withstand the tests specified in section 14 without leakage. The press-connect ends shall be assembled in accordance with the fitting manufacturer's installation instructions. The dimensions and tolerances of the press-connect ends shall be as shown in Table 9.1-1.

9.2 Out-of-Roundness of Fitting End (P or FTG)

Maximum out-of-roundness of the press-connect fitting ends, dimensions A and F , shall not exceed 1% of the maximum corresponding diameters shown in Table 9.1-1. The average of the maximum and minimum diameters shall be within the dimensions shown in Table 9.1-1.

9.3 Inside Diameter of Fitting

The minimum cross-sectional area of the inside diameter through the fitting body shall not be less than the theoretical minimum area defined by diameter O in Table 9.1-1. The out-of-roundness condition of the cross-sectional area shall not exceed 10% of the minimum diameter shown in Table 9.1-1.

For reducer or adapter fittings, the smallest end diameter shall apply, provided that this diameter does not restrict the other outlets.

9.4 Wall Thickness

The minimum wall thickness taken at any location of the fitting shall not be less than shown in Table 9.1-1.

10 THREADED ENDS

The threaded ends shall have right-hand nominal pipe taper (NPT) threads conforming to ASME B1.20.1.

10.1 Countersink or Chamfer

All internal threads shall be countersunk a distance no less than one-half the pitch of the thread, at an angle of approximately 45 deg with the axis of the thread. All external threads shall be chamfered at an angle of 30 deg to 45 deg from the axis. Countersinking and chamfering shall be concentric with the threads. The length of threads shall be measured to include the countersink or chamfer.

10.2 Threading Tolerances

NPT threads shall be checked by use of a plug or ring gage in either standard or limit types. When gaging internal taper threads, the plug gage shall be screwed hand-tight into the fitting. The reference point for gaging internal product-threads depends on the chamfer diameter. When the internal chamfer diameter exceeds the major diameter of the internal thread, the reference point shall be the last thread scratch on the chamfer cone. Otherwise, when the internal chamfer diameter does not exceed the major diameter of the internal thread, the reference point shall be the end of the fitting. In gaging external taper threads, the ring gage shall be screwed hand-tight on the external thread. On the external thread, the ring gage shall be flush with the end of the thread.

Tolerance for an internal threaded end having an internal shoulder shall be from the gage reference point (notch) to one turn small. Tolerance for an internally threaded end without a shoulder and for an externally threaded end shall be from one turn small to one turn large.

10.3 Design of Threaded Ends

The wrenching section of internally threaded ends shall be polygonal, and the wrenching section of externally threaded ends shall be furnished with either polygon or flats, at the manufacturer's option.

11 ALIGNMENT

The maximum allowable deviation in the angular alignment of any end from the specified axis position shall be $\frac{1}{2}$ deg (1 deg total). See Figure 11-1.

12 GAGING

12.1 Preferred Gaging Method of Press-Joint Ends

The preferred method of gaging the diameter tolerances for external and internal ends shall be by the use of plain plug and ring gages designed to hold the product within the limits established in Table 9.1-1. Gage tolerances shall be Class ZM, as defined in ANSI B4.4M.

12.2 Optional Gaging Method of Press-Connect Pressure Fittings

For gaging the diameter tolerance of external and internal ends, the use of direct-reading instruments instead of ring and plug gages as specified in para. 12.1 shall be permitted. When gaging the diameters of external and internal ends using direct-reading instruments, refer to para. 9.2.

12.3 Standard Gaging Method of Threaded Ends

The standard method of gaging the externally and internally threaded ends shall be in accordance with the requirements of ASME B1.20.1.

NOTE: In gaging pipe threads, it is acceptable and common practice to rap or tap the part to ensure proper seating of the gage. However, it is first necessary to clean both the gage and the product threads to ensure that they are free of chips, burrs, abrasives, or other foreign materials.

13 INSTALLATION INSTRUCTIONS

The manufacturer of press-connection fittings shall provide instructions for the installation of the fittings. The instructions shall provide a minimum of

- (a) end preparation of the tube
- (b) assembly of copper tube to the fitting
- (c) requirements for the tool used to form the press-connect joint
- (d) pressing procedure

Installation instructions shall include details to enable assemblers to install fittings with performance consistent with that demonstrated by the design qualification testing described in [section 14](#).

The pressure-temperature ratings are only applicable to fittings that are installed in accordance with the manufacturer's instructions.

14 DESIGN QUALIFICATION

14.1 General

Press-connection fittings shall be qualified with the performance tests defined herein. The fittings shall be tested with both ASTM Type K and Type M hard-drawn tube, so two sets of tests are required, except for the thermocycle test described in [para. 14.9](#).

Manufacturers shall retain test reports demonstrating compliance with this Standard. For any design change, the performance tests shall be repeated.

Press connection of the test assemblies shall be done according to the fitting manufacturer's installation instructions. Each test shall be performed on a new test assembly.

14.2 Hydrostatic Pressure Test at 20°C (68°F)

14.2.1 Test Assembly. The test assembly shall contain a press-connection fitting located between two sections of copper tube as shown in [Figure 14.2.1-1](#). The sample shall not be restrained in the test assembly. The sample shall be filled with water to a pressure of 4 140 kPa \pm 50 kPa (600 psi \pm 7 psi) at a temperature of 20°C \pm 5°C (68°F \pm 9°F) for a period of 48 h.

14.2.2 Acceptance Criteria. During the first hour, the maximum slippage of each joint shall be as specified in [Table 14.2.2-1](#). Once the 1-h slippage is recorded, the maximum additional slippage shall not exceed the distance specified in [Table 14.2.2-1](#). During the test, there shall be no visible leakage of the joint.

14.3 Unrestrained Hydrostatic Pressure Test at 93°C (200°F)

14.3.1 Test Assembly. The test assembly shall contain a press-connect fitting located between two sections of copper tube as shown in [Figure 14.2.1-1](#). The sample shall not be restrained in the test assembly. The sample shall be filled with water to a pressure of 4 140 kPa \pm 50 kPa (600 psi \pm 7 psi) and held at a temperature of 93°C \pm 2°C (200°F \pm 5°F) for a period of 48 h.

14.3.2 Acceptance Criteria. The acceptance criteria shall be as defined in [para. 14.2.2](#).

14.4 Static Torque Test

14.4.1 Test Assembly. Prepare samples with a copper press-connect coupling joining two equal lengths of hard-drawn copper tube. One end of the test assembly shall be fixed and the other end fabricated to accommodate a moment arm, as shown in [Figure 14.4.1-1](#). Each test assembly with a press-connect fitting shall have a minimum torque applied as specified in [Table 14.4.1-1](#).

After applying the torque, release the force and subject the sample to a water pressure test of 2 760 kPa \pm 50 kPa (400 psi \pm 7 psi) gage pressure for a period of 48 h at a temperature of 20°C \pm 5°C (68°F \pm 9°F).

14.4.2 Acceptance Criteria. The press-connect fitting shall withstand the minimum torque listed in [Table 14.4.1-1](#). During the test, there shall be no visible leakage of the joint.

14.5 Bending Test

14.5.1 Test Assembly. A test assembly shall have two 1 020 mm (40 in.) lengths of hard-drawn copper tube joined with a coupling with an internal stop. The sample shall be centered between supports spaced 1 829 mm (6.0 ft) apart as shown in [Figure 14.5.1-1](#). A concentrated load shall be applied to the center of the span at the center of the coupling. The concentrated load shall be in accordance with [Table 14.5.1-1](#). A hydrostatic internal pressure of 4 140 kPa \pm 50 kPa (600 psi \pm 7 psi) shall be applied and maintained for a period of 1 h at a temperature of 20°C \pm 5°C (68°F \pm 9°F).

14.5.2 Acceptance Criteria. During the test, there shall be no visible leakage of the joint.

14.6 Vacuum Test

14.6.1 Test Assembly. A test assembly shall have a press-connect fitting.

The sample shall be subjected to a vacuum of $-83 \text{ kPa} \pm 2 \text{ kPa}$ ($-24.5 \text{ in. Hg} \pm 0.5 \text{ in. Hg}$) at a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$). Once the vacuum is established, the sample shall be isolated. The vacuum shall be maintained for a period of 1 h.

14.6.2 Acceptance Criteria. The maximum change in vacuum shall not exceed 3.4 kPa (1.0 in. Hg) within the 1-h test period.

14.7 Cyclic Pressure Test

14.7.1 Test Assembly. The test assembly shall have a minimum of one press-connect fitting. The sample shall be installed in a system filled with water at a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$) pressurized to $100 \text{ kPa} \pm 10 \text{ kPa}$ ($14.7 \text{ psi} \pm 1.5 \text{ psi}$). The specimen shall be subjected to a hydraulic shock of $2\,760 \text{ kPa} \pm 200 \text{ kPa}$ ($400 \text{ psi} \pm 29 \text{ psi}$) for 10 000 cycles at a sinusoidal pressure with a frequency of 0.5 Hz.

14.7.2 Acceptance Criteria. During the test, there shall be no visible leakage of the joint.

14.8 Vibration Test

14.8.1 Test Assembly. A test assembly shall be fabricated using five lengths of copper tube, two couplings, and two elbows as shown in [Figure 14.8.1-1](#). Two lengths of tube shall be connected with press-connect couplings. Press-connect elbows shall join the three remaining lengths. The sample shall be installed in a test assembly that subjects the system to a vibration while pressurized to $2\,760 \text{ kPa} \pm 50 \text{ kPa}$ ($400 \text{ psi} \pm 7 \text{ psi}$). The test assembly shall be subjected to 1 000 000 vibration cycles. A vibration cycle shall be a forward and reverse movement of 1 mm (0.04 in.) at a frequency of $20 \text{ Hz} \pm 2 \text{ Hz}$. After the vibration cycling, the sample shall be hydrostatically tested to a pressure of $4\,140 \text{ kPa} \pm 50 \text{ kPa}$ ($600 \text{ psi} \pm 7 \text{ psi}$) for a period of 30 min at a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$).

14.8.2 Acceptance Criteria. During the test, there shall be no visible leakage of the joint.

14.9 Thermocycling Test

14.9.1 Test Assembly. A test assembly shall be constructed using Type L copper tube and press-connect fittings in accordance with [Figure 14.9.1-1](#). The specimen shall be installed in a test assembly that permits the flow of oxygenated water at a pressure of $1\,000 \text{ kPa} \pm 50 \text{ kPa}$ ($145 \text{ psi} \pm 7 \text{ psi}$). Flow water at a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$) through the specimen for a period of 15 min for nominal size 2 and smaller, and 30 min for nominal size $2\frac{1}{2}$ and larger. Change the flow to hot water at a temperature of $93^\circ\text{C} \pm 5^\circ\text{C}$ ($200^\circ\text{F} \pm 9^\circ\text{F}$) for a period of 15 min for nominal size 2 and smaller, and 30 min for nominal size $2\frac{1}{2}$ and larger. Continue this cycling for 5 000 cycles for nominal size 2 and smaller, and 2 500 cycles for nominal size $2\frac{1}{2}$ and larger. The water temperature in the piping shall reach the change in temperature within a period of 2 min.

14.9.2 Acceptance Criteria.

(a) During the test, there shall be no visible leakage of the joint.

(b) The elastomeric material shall conform to [para. 6.3\(d\)](#).

14.10 Dynamic Torque Test

14.10.1 Test Assembly. Prepare two samples with a copper press-connect coupling joining two lengths of copper tube. Install one test assembly in a dynamic torque test assembly that twists the tube at the nonfixed end, with respect to the coupling, $5 \text{ deg} \pm 0.5 \text{ deg}$, as shown in [Figure 14.10.1-1](#). At a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$), cycle the specimen 10 000 times (a cycle is twisting one direction, reversing, and twisting in the other direction). Repeat the test with the second sample at a temperature of $93^\circ\text{C} \pm 2^\circ\text{C}$ ($200^\circ\text{F} \pm 5^\circ\text{F}$). After completing the twisting cycles, the samples shall be hydrostatically tested to a pressure of $2\,760 \text{ kPa} \pm 50 \text{ kPa}$ ($400 \text{ psi} \pm 7 \text{ psi}$) for a period of 1 h at a temperature of $20^\circ\text{C} \pm 5^\circ\text{C}$ ($68^\circ\text{F} \pm 9^\circ\text{F}$).

14.10.2 Acceptance Criteria. During the test, there shall be no visible leakage of the joint.

Figure 3.1-1
Method of Designating Laying Lengths of Fittings and Openings of Reducing Fittings



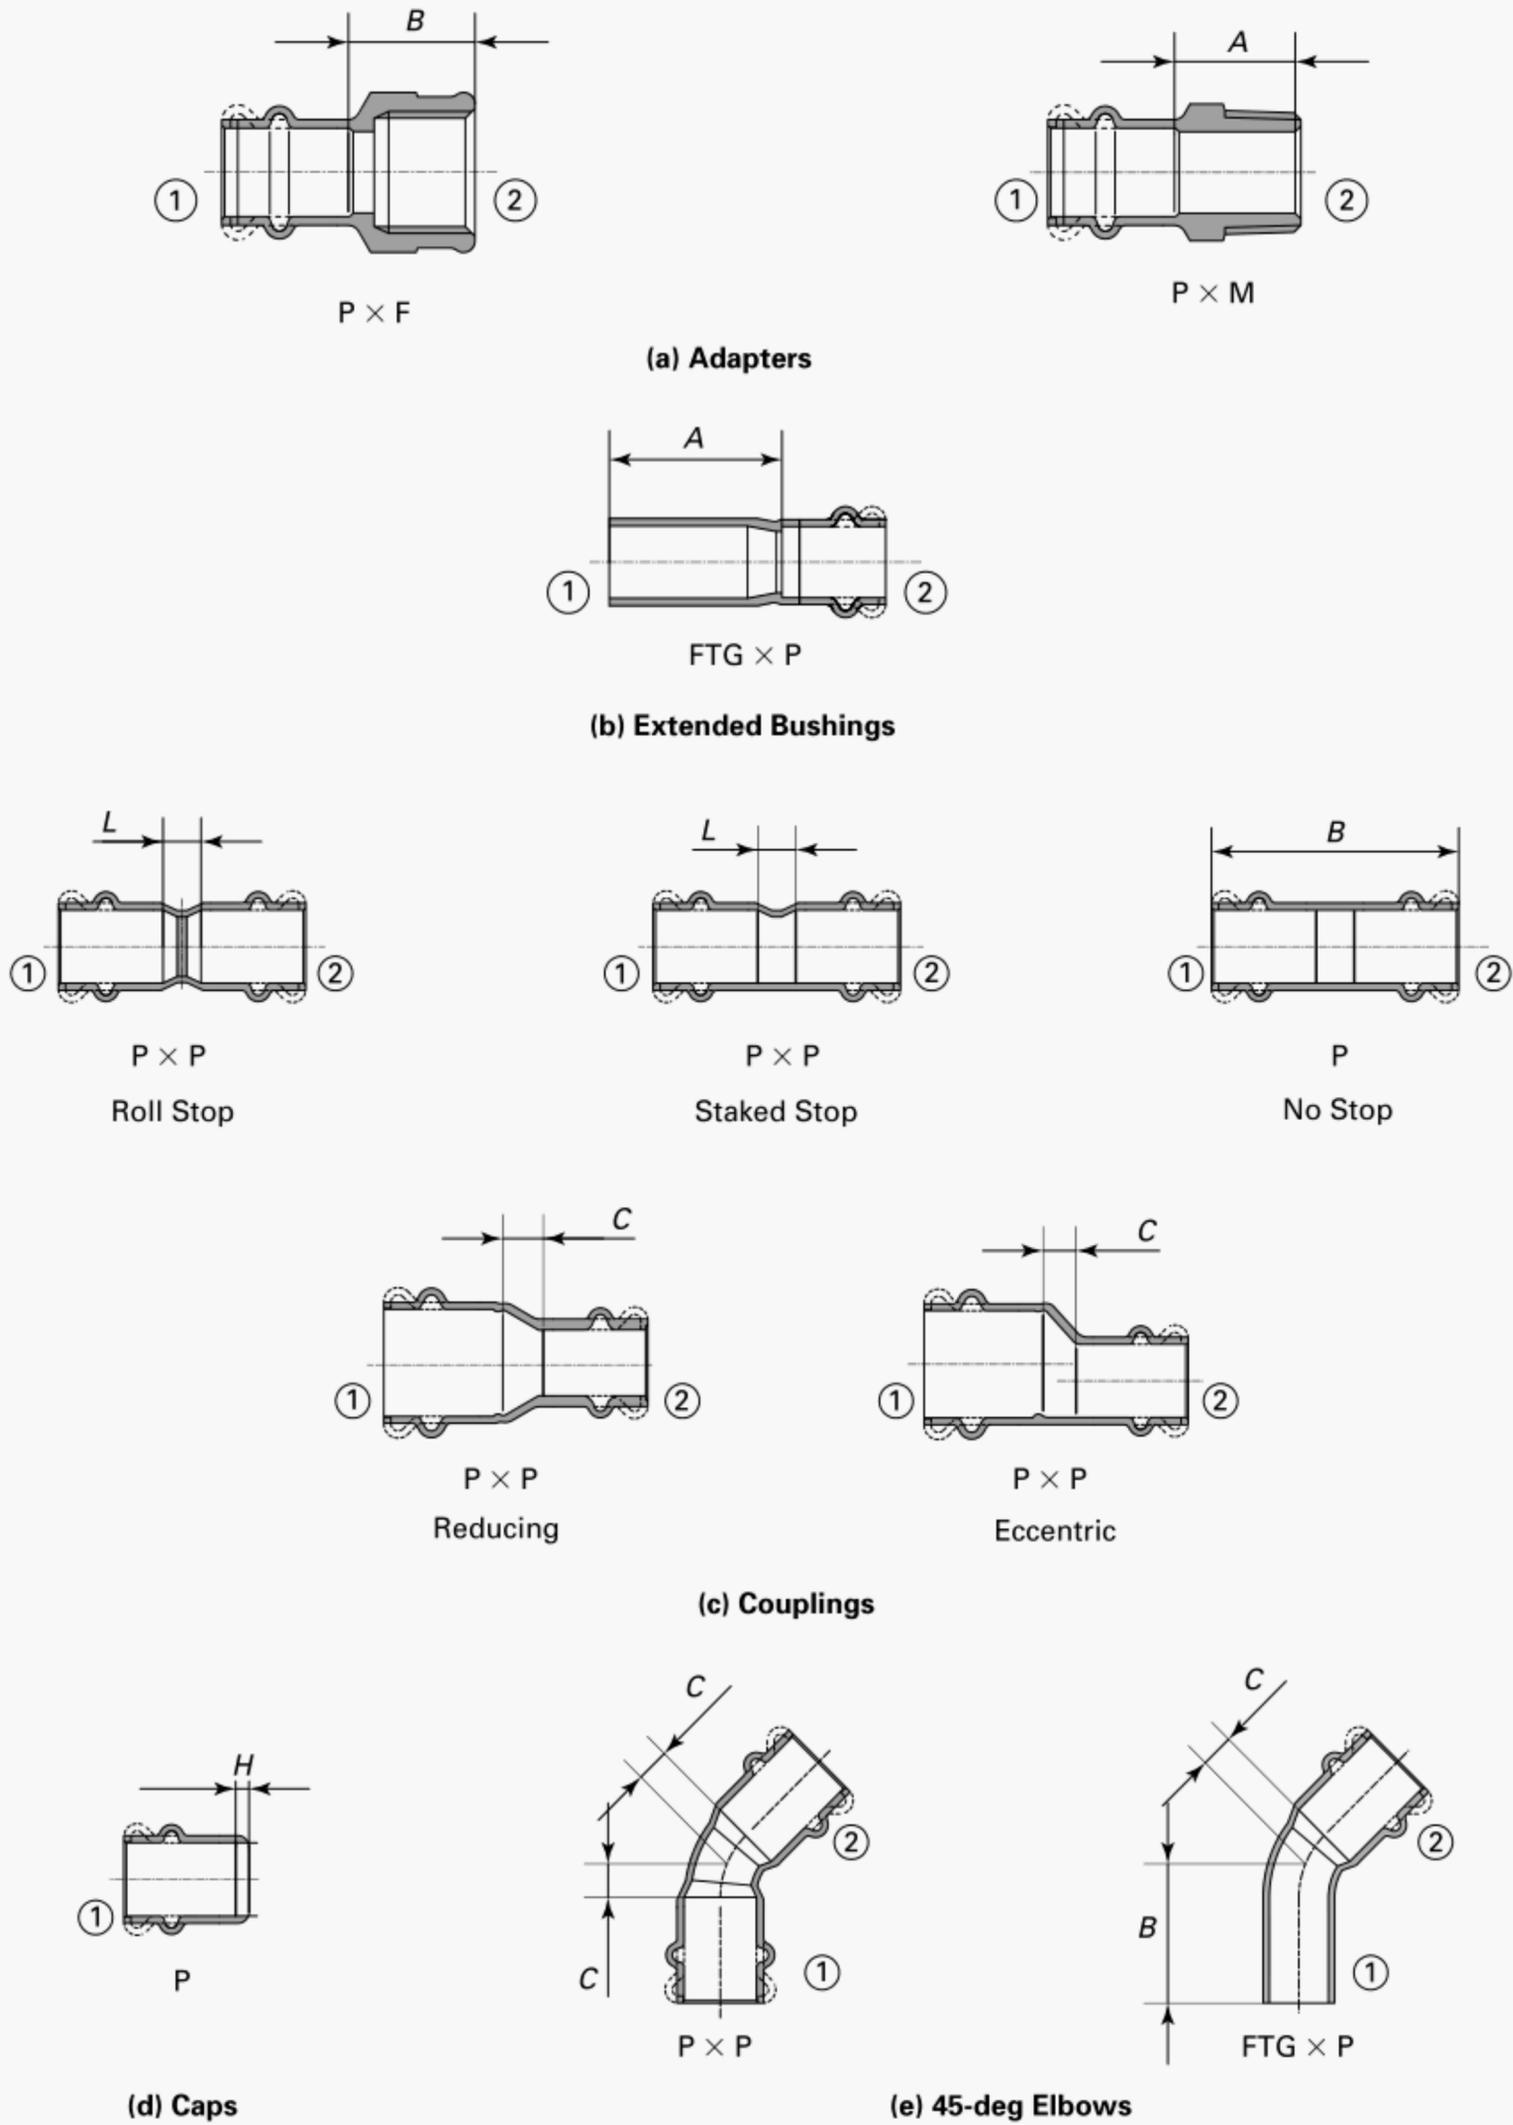



Figure 3.1-1
Method of Designating Laying Lengths of Fittings and Openings of Reducing Fittings (Cont'd)

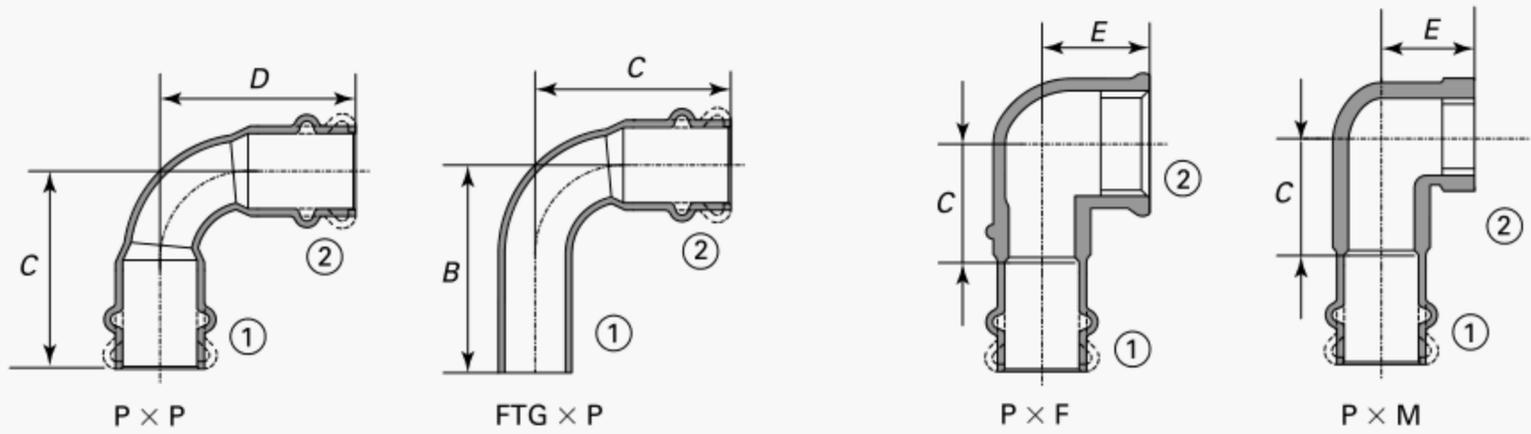


(f) 90-deg Elbows, Short Radius

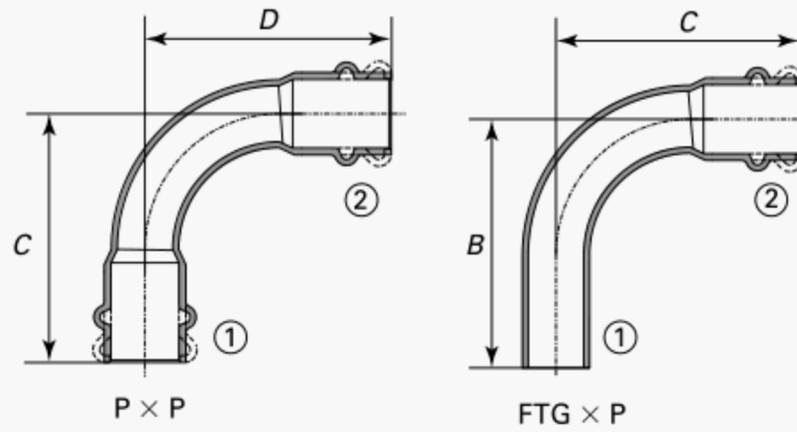


(g) 90-deg Elbows, Long Radius

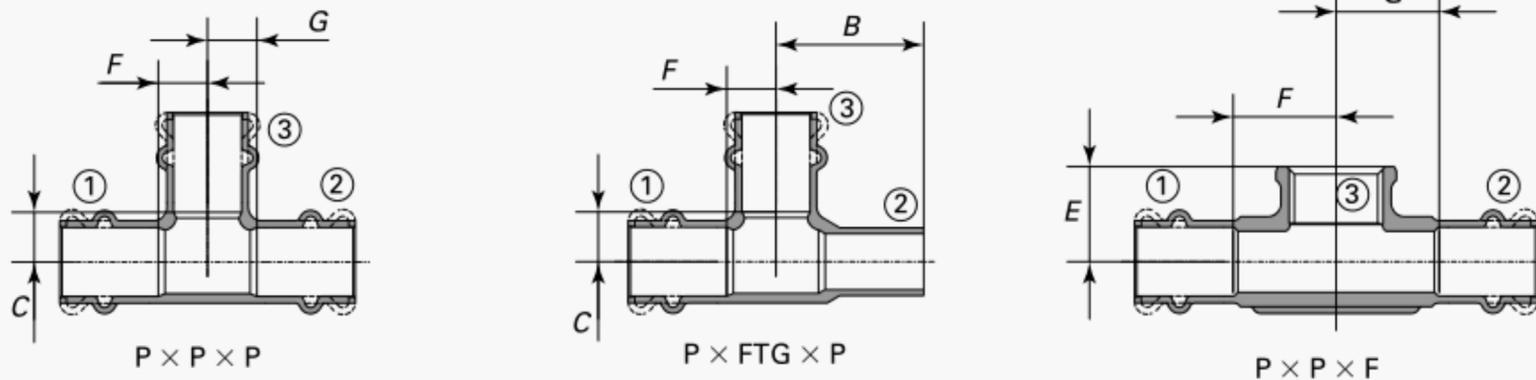

(h) Tees

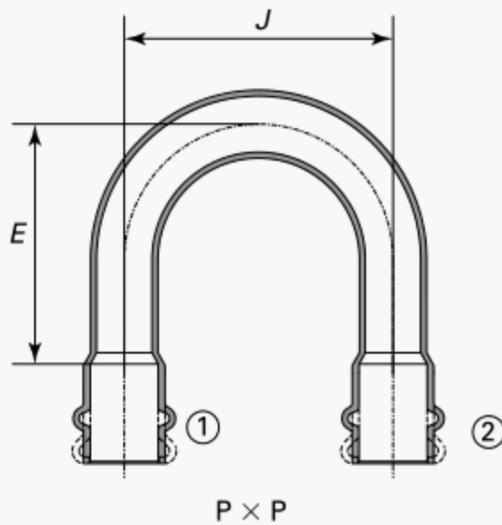

(i) Return Bends

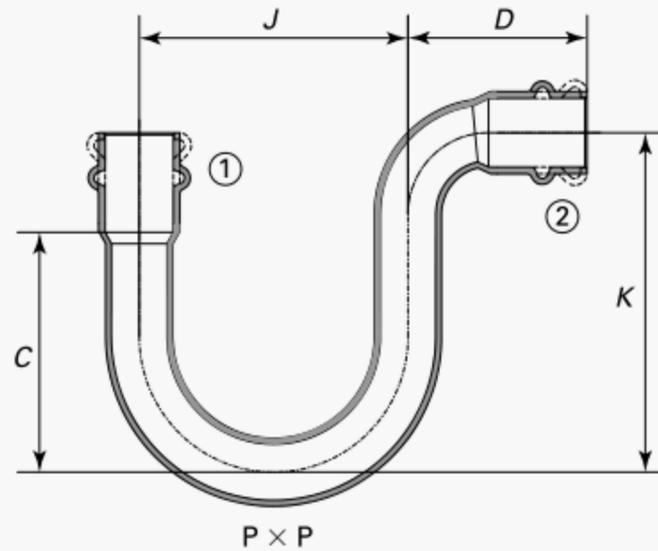


(j) Suction Line P-Traps

GENERAL NOTES:

- (a) Fittings are designated by size in the following order: 1 \times 2 \times 3 (designated in circles above).
- (b) Fitting designs and drawings are illustrative only.
- (c) Number of O-rings and locations shall be specified by the manufacturer and are shown for two typical locations.
- (d) Dimensions A through L shall be specified by the manufacturer.

**Table 9.1-1
Dimensions of Press-Connect Ends**

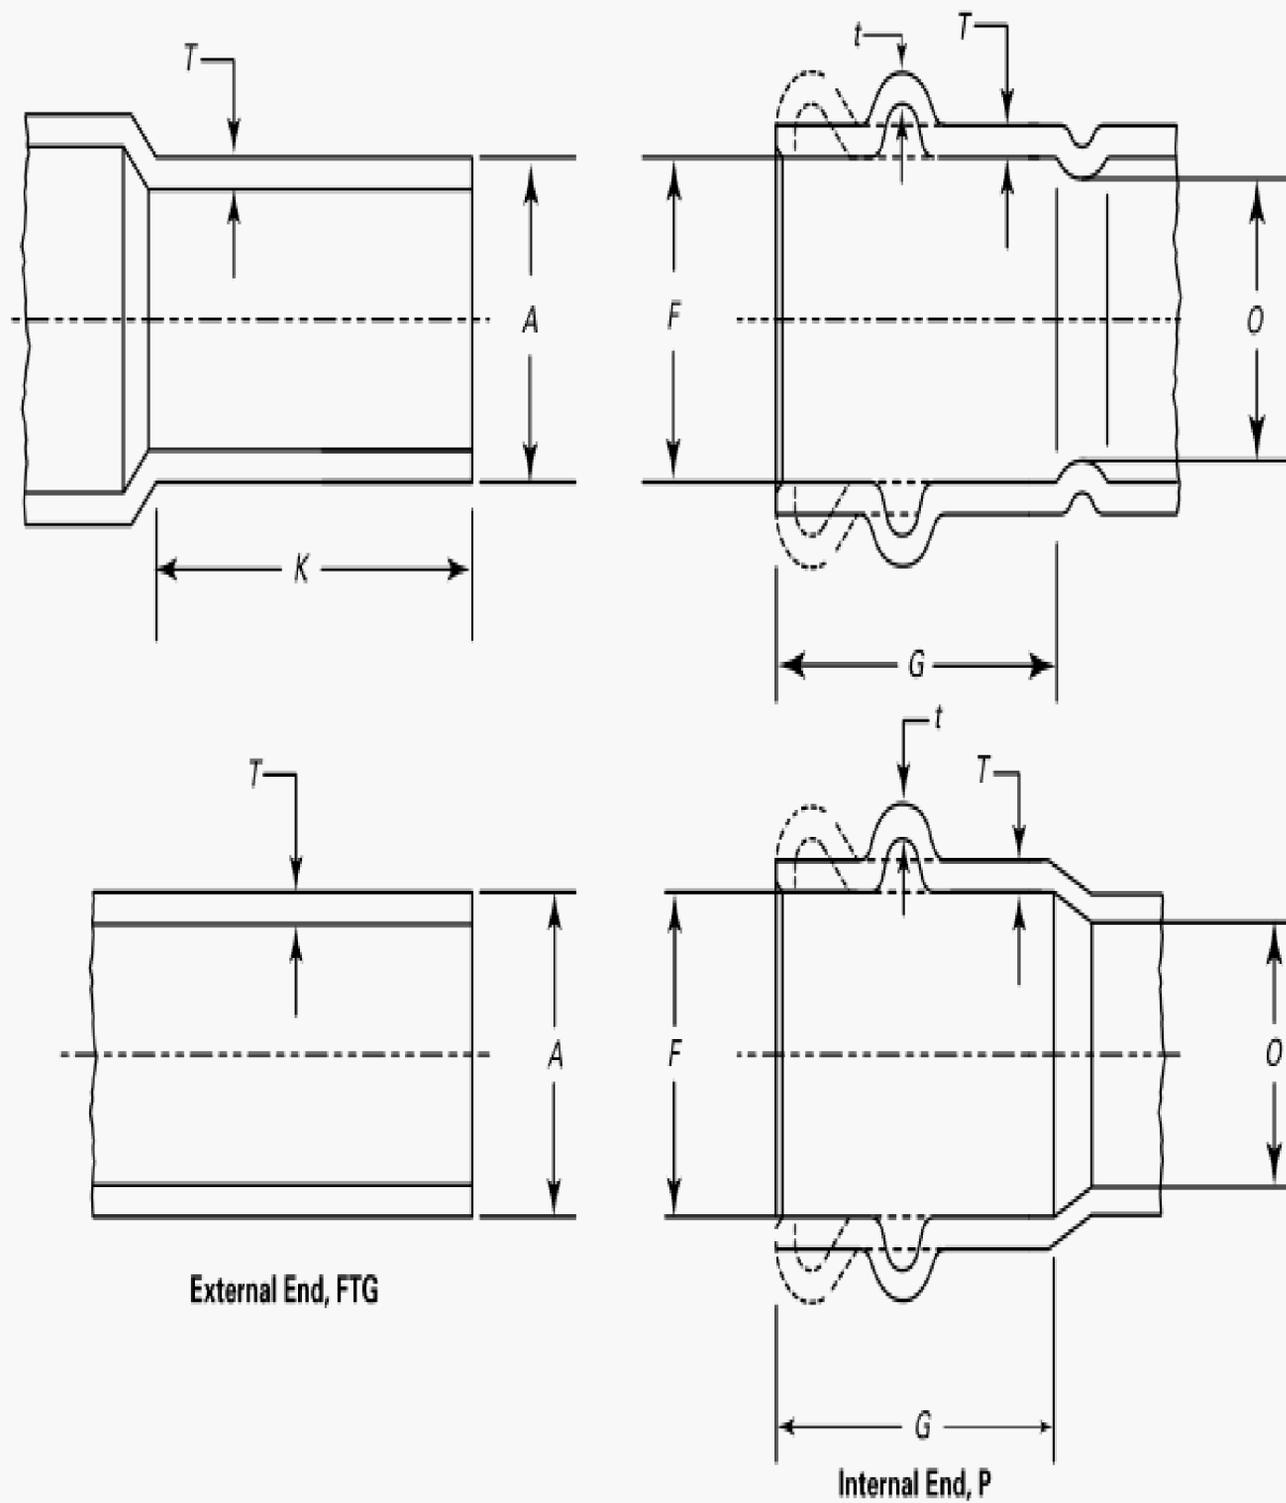

8

ASME B16.51-2021

Standard Water Tube Size [Note (1)]	External End		Minimum Length, K , mm (in.) [Note (2)]	Internal End			Wall Thickness, mm (in.)				Minimum Inside Diameter of Fitting, O , mm (in.)
	Outside Diameter, A , mm (in.)			Inside Diameter, F , mm (in.)		Depth, G , mm (in.) [Note (3)]	Minimum Wrought		Minimum Cast		
	Min.	Max.	Min.	Max. [Note (3)]	T		t	T	t		
$\frac{3}{8}$	12.62 (0.497)	12.73 (0.501)	11.2 (0.44)	12.75 (0.502)	0.66 (0.026)	0.46 (0.018)	1.27 (0.05)	1.27 (0.05)	9.9 (0.39)
$\frac{1}{2}$	15.80 (0.622)	15.90 (0.626)	14.2 (0.56)	15.93 (0.627)	0.74 (0.029)	0.52 (0.020)	1.27 (0.05)	1.27 (0.05)	13.2 (0.52)
$\frac{3}{4}$	22.15 (0.872)	22.25 (0.876)	20.6 (0.81)	22.28 (0.877)	0.84 (0.033)	0.59 (0.023)	1.27 (0.05)	1.27 (0.05)	18.8 (0.74)
1	28.50 (1.122)	28.63 (1.127)	24.6 (0.97)	28.65 (1.128)	1.02 (0.040)	0.71 (0.028)	1.27 (0.05)	1.27 (0.05)	24.9 (0.98)
$1\frac{1}{4}$	34.85 (1.372)	34.98 (1.377)	26.2 (1.03)	35.00 (1.378)	1.12 (0.044)	0.78 (0.031)	1.27 (0.05)	1.27 (0.05)	31.2 (1.23)

**Table 9.1-1
Dimensions of Press-Connect Ends (Cont'd)**

Standard Water Tube Size [Note (1)]	External End		Minimum Length, K, mm (in.) [Note (2)]	Internal End			Wall Thickness, mm (in.)				Minimum Inside Diameter of Fitting, O, mm (in.)
	Outside Diameter, A, mm (in.)			Inside Diameter, F, mm (in.)		Depth, G, mm (in.) [Note (3)]	Minimum Wrought		Minimum Cast		
	Min.	Max.	Min.	Max. [Note (3)]	T		t	T	t		
1½	41.17 (1.621)	41.33 (1.627)	29.5 (1.16)	41.35 (1.628)	1.30 (0.051)	0.91 (0.036)	1.78 (0.07)	1.78 (0.07)	37.3 (1.47)
2	53.87 (2.121)	54.03 (2.127)	35.8 (1.41)	54.05 (2.128)	1.50 (0.059)	1.05 (0.041)	1.78 (0.07)	1.78 (0.07)	49.3 (1.94)
2½	66.57 (2.621)	66.73 (2.627)	38.9 (1.53)	66.75 (2.628)	1.70 (0.067)	1.19 (0.047)	3.00 (0.12)	3.00 (0.12)	61.5 (2.42)
3	79.27 (3.121)	79.43 (3.127)	43.7 (1.72)	79.45 (3.128)	1.91 (0.075)	1.34 (0.053)	3.00 (0.12)	3.00 (0.12)	73.4 (2.89)
3½	91.97 (3.621)	92.13 (3.627)	50.0 (1.97)	92.15 (3.628)	2.18 (0.086)	1.53 (0.060)	3.00 (0.12)	3.00 (0.12)	85.6 (3.37)
4	104.67 (4.121)	104.83 (4.127)	56.4 (2.22)	104.85 (4.128)	2.44 (0.096)	1.71 (0.067)	3.00 (0.12)	3.00 (0.12)	97.5 (3.84)


GENERAL NOTES:

- (a) Drawings and designs of fittings are illustrative only.
- (b) Number of O-rings and locations shall be specified by the manufacturer and are shown for two typical locations.

NOTES:


- (1) For size designation of fittings, see [section 4](#).
- (2) The distance from the point of tangency, at the gage inside diameter to the gage line, shall be equal to the dimension shown under the column titled External End, Minimum Length, K.
- (3) The maximum inside diameter and depth of the internal end shall be at the option of the manufacturer.

**Figure 8-1
Tube Stops**

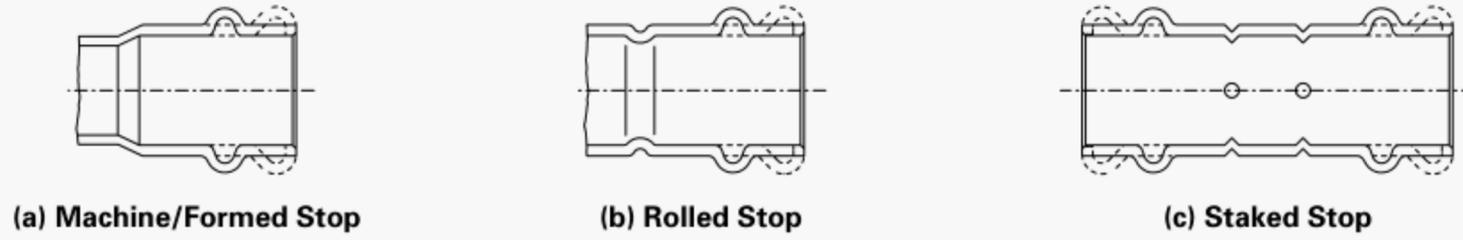


GENERAL NOTE: This figure is for information only; the shape and number of stops shall be at the manufacturer's discretion.

**Figure 11-1
Alignment**

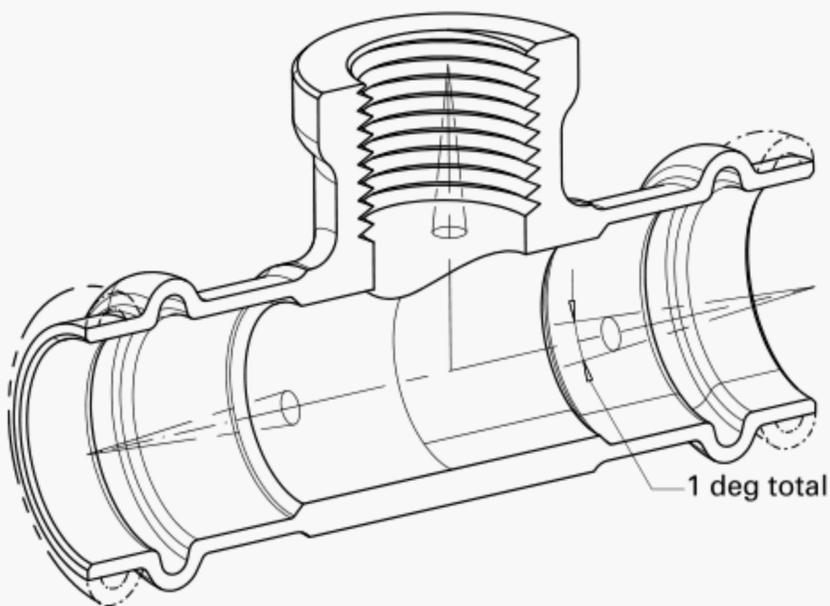

GENERAL NOTE: This figure is for illustration only.

**Figure 14.2.1-1
Test Setup for Pressure Test**

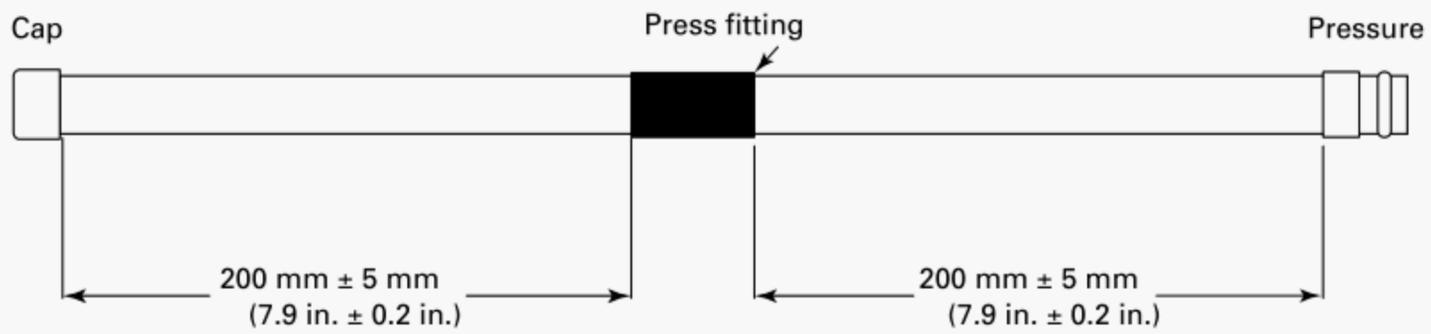


**Table 14.2.2-1
Maximum Slippage**

Standard Water Tube Size	Maximum Slippage, mm (in.), per Joint During First Hour	Maximum Additional Slippage, mm (in.), per Joint After First Hour
3/8	0.3 (0.012)	0.05 (0.002)
1/2	0.3 (0.012)	0.05 (0.002)
3/4	0.5 (0.021)	0.05 (0.002)
1	0.8 (0.032)	0.05 (0.002)
1 1/4	1.0 (0.039)	0.05 (0.002)
1 1/2	1.5 (0.059)	0.05 (0.002)
2	2.0 (0.079)	0.05 (0.002)
2 1/2	2.5 (0.098)	0.1 (0.004)
3	3.0 (0.118)	0.1 (0.004)
3 1/2	3.5 (0.138)	0.1 (0.004)
4	4.0 (0.157)	0.1 (0.004)


**Table 14.4.1-1
Torque**

Standard Water Tube Size	Torque, N·m (lb-ft)
3/8	11 (8)
1/2	20 (15)
3/4	25 (18)
1	40 (29)
1 1/4	55 (41)
1 1/2	70 (52)
2	100 (74)
2 1/2	130 (96)
3	165 (122)
3 1/2	200 (147)
4	240 (177)

**Figure 14.4.1-1
Test Setup for Static Torque Test**

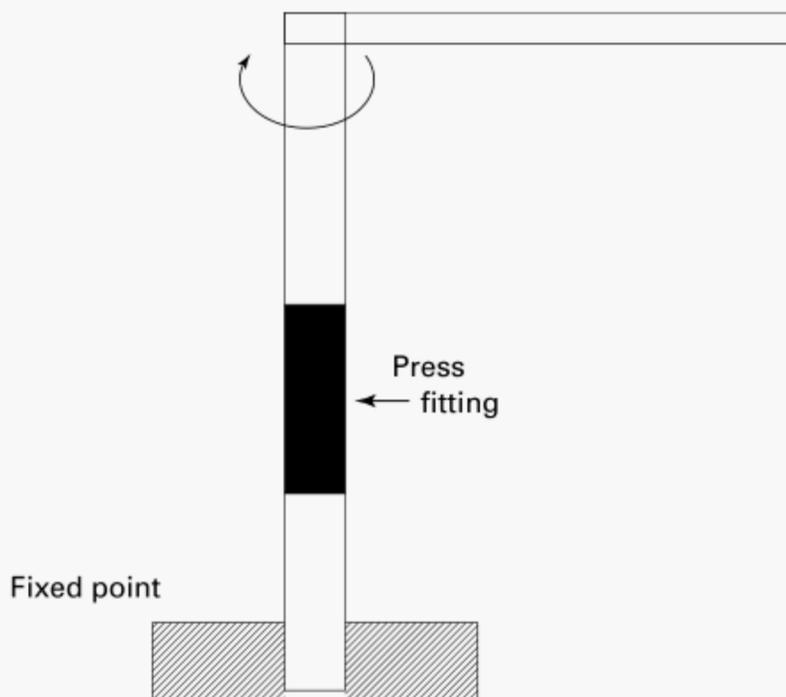


**Figure 14.5.1-1
Test Setup for Bending Test**

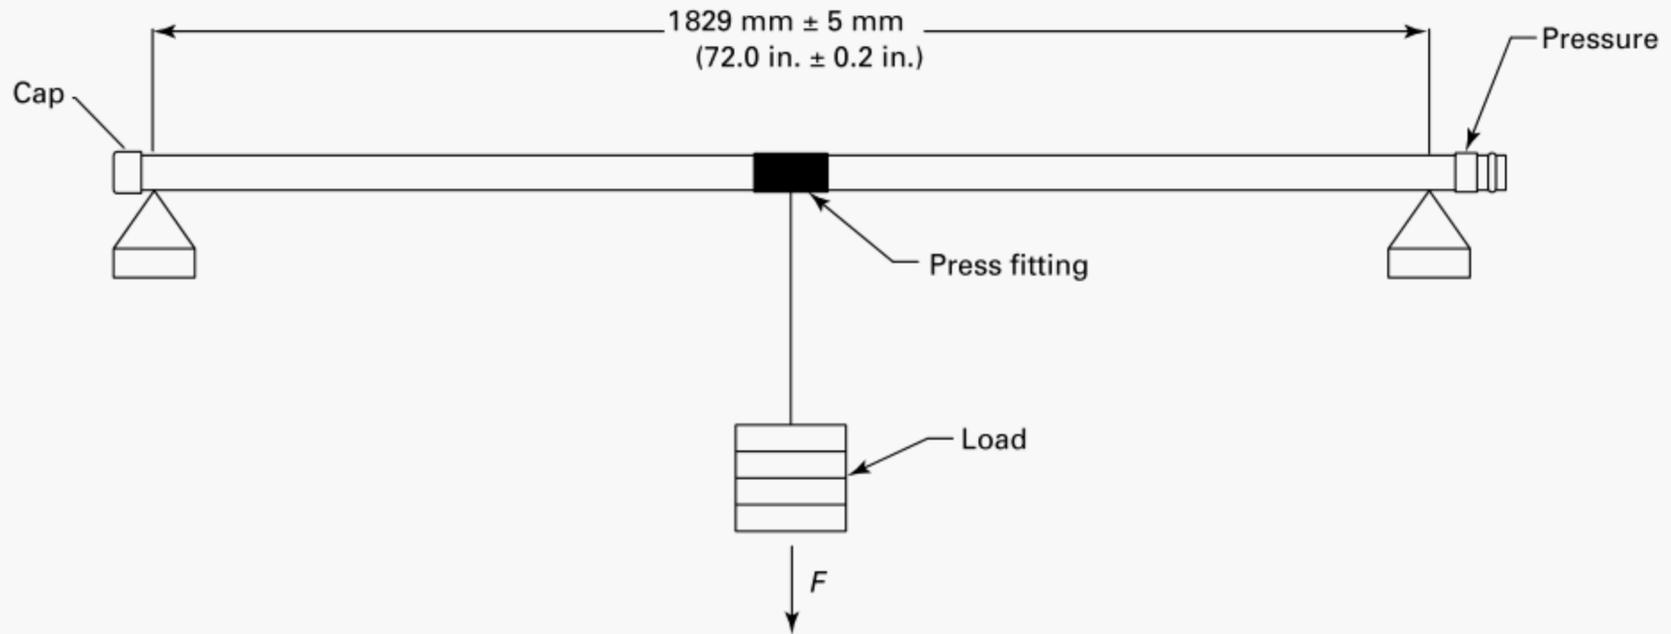


**Table 14.5.1-1
Concentrated Load**

Standard Water Tube Size	Static Load, N·m (lb-ft)
3/8	40 (9)
1/2	110 (25)
3/4	180 (40)
1	240 (53)
1 1/4	310 (68)
1 1/2	380 (84)
2	500 (110)
2 1/2	630 (138)
3	770 (170)
3 1/2	920 (204)
4	1 090 (240)


Figure 14.8.1-1
Test Setup for Vibration Test

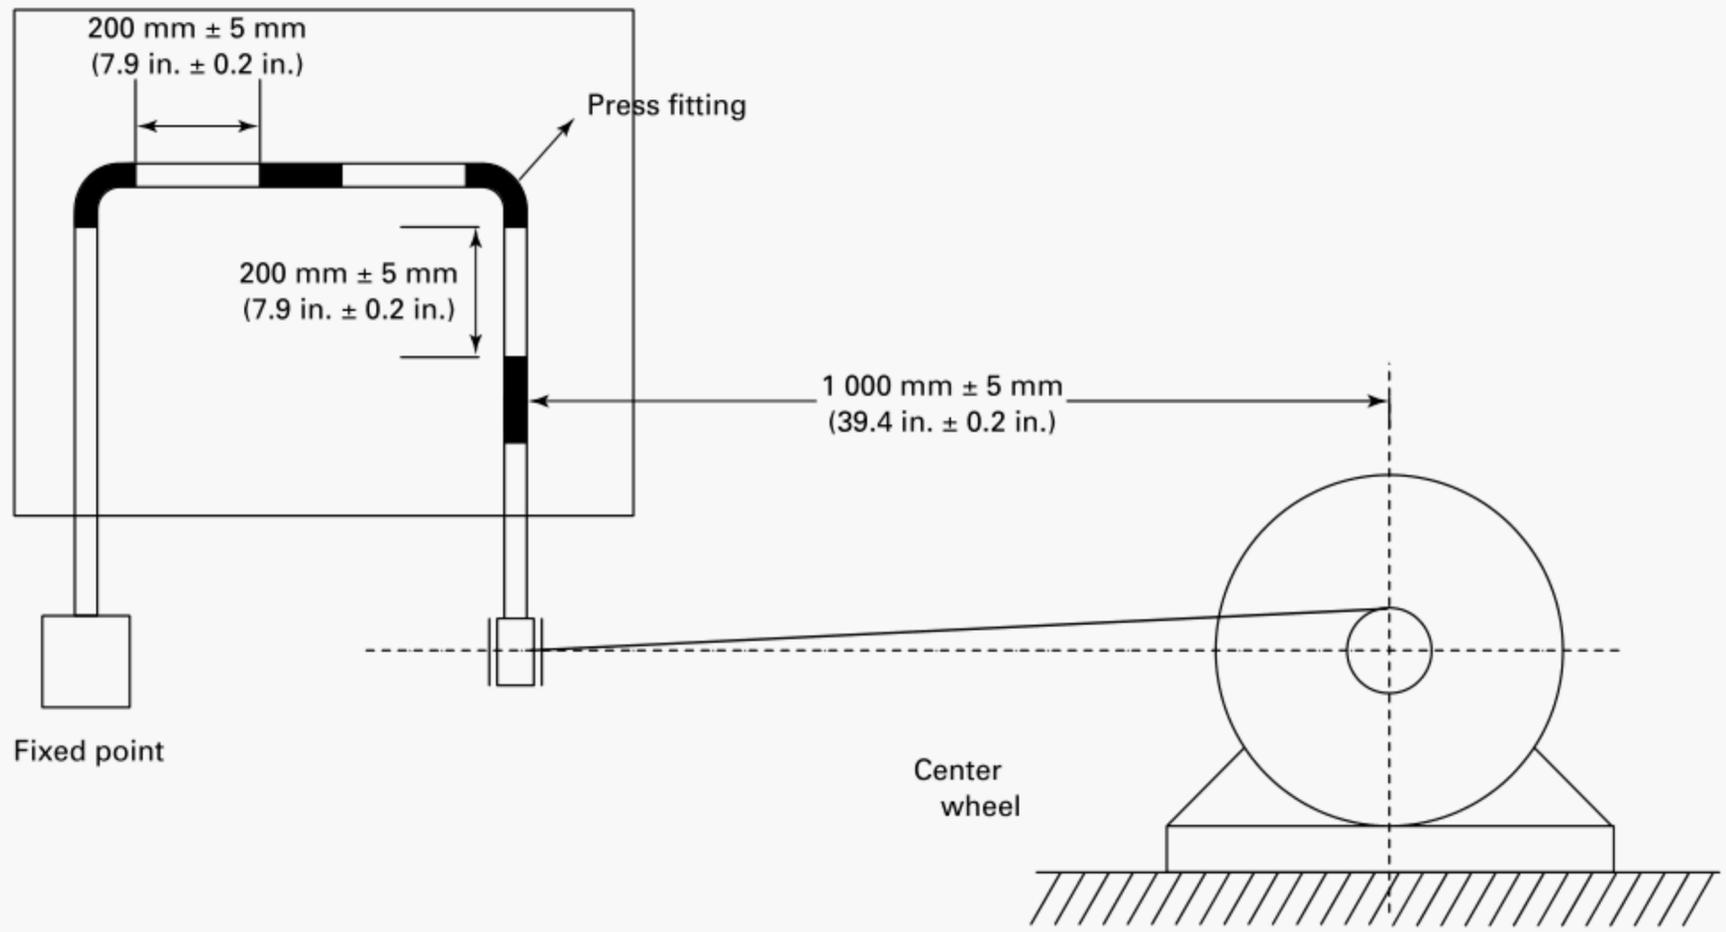

**Figure 14.9.1-1
Test Setup for Thermocycling Test**

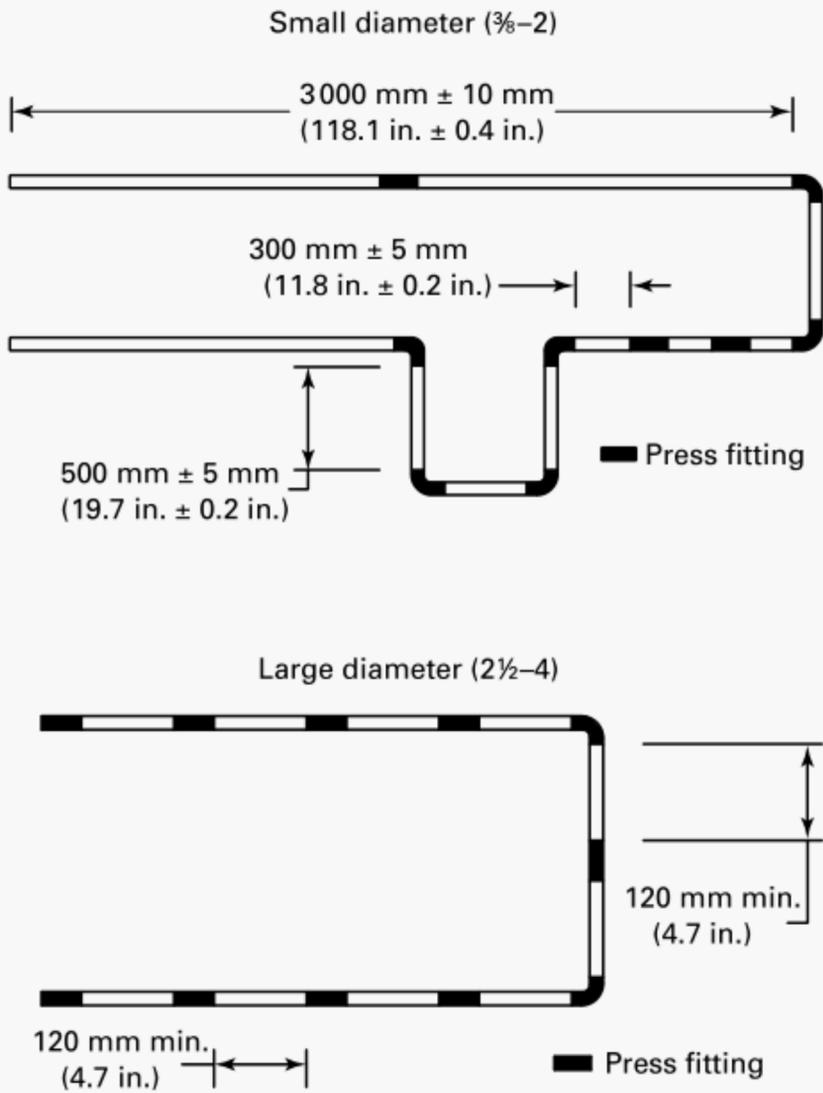

**Figure 14.10.1-1
Test Setup for Dynamic Torque Test**

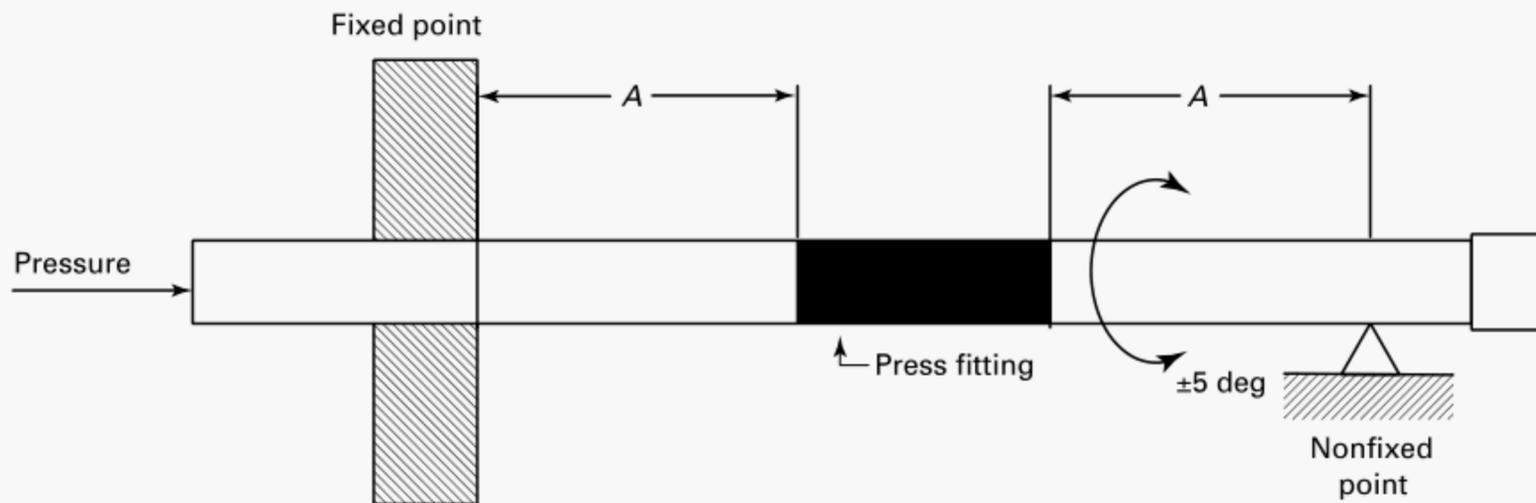

Tubing Size	Distance, A , mm (in.)
$\frac{3}{8}$ -2 $\frac{1}{2}$	$400 \text{ mm} \pm 5 \text{ mm}$ ($15.7 \text{ in.} \pm 0.2 \text{ in.}$)
3-4	$600 \text{ mm} \pm 5 \text{ mm}$ ($23.6 \text{ in.} \pm 0.2 \text{ in.}$)

MANDATORY APPENDIX I REFERENCES

(21)

The following is a list of publications referenced in this Standard. Unless otherwise specified, the latest edition of ASME publications shall apply. Materials manufactured to other editions of the referenced ASTM standards shall be permitted to be used to manufacture fittings meeting the requirements of this Standard as long as the fitting manufacturer verifies the material meets the requirements of the referenced edition.

ASME B1.20.1, Pipe Threads, General Purpose (Inch)
 Publisher: The American Society of Mechanical Engineers (ASME), Two Park Avenue, New York, NY 10016-5990 (www.asme.org)

ANSI B4.4M-1981 (R1994), Inspection of Workpieces
 Publisher: The American National Standards Institute (ANSI), 25 West 43rd Street, New York, NY 10036 (www.ansi.org)

ANSI MSS SP-25-2018, Standard Marking System for Valves, Fittings, Flanges, and Unions
 Publisher: Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS), 127 Park Street NE, Vienna, VA 22180-4602 (www.mss-hq.org)

ASTM B32-08(2014), Standard Specification for Solder Metal

ASTM B62-17, Standard Specification for Composition Bronze or Ounce Metal Castings

ASTM B88-16, Standard Specification for Seamless Copper Water Tube

ASTM B584-14, Standard Specification for Copper Alloy Sand Castings for General Applications

ASTM D2000-12(2017), Standard Classification System for Rubber Products in Automotive Applications

ASTM D395-18, Standard Test Methods for Rubber Property—Compression Set

ASTM D6284-17, Standard Test Method for Rubber Property—Effect of Aqueous Solutions with Available Chlorine and Chloramine

ASTM E29-13(2019), Standard Practice for Using Significant Digits in Test Data to Determine Conformance with Specifications

Publisher: American Society for Testing and Materials (ASTM International), 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959 (www.astm.org)

ISO 9000:2015, Quality management systems — Fundamentals and vocabulary¹

ISO 9001:2015, Quality management systems — Requirements¹

ISO 9004:2009, Managing for the sustained success of an organization — A quality management approach¹

Publisher: International Organization for Standardization (ISO), Central Secretariat, Chemin de Blandonnet 8, Case Postale 401, 1214 Vernier, Geneva, Switzerland (www.iso.org)

NSF/ANSI 61-2017, Drinking Water System Components — Health Effects

Publisher: NSF International (NSF), 789 North Dixboro Road, Ann Arbor, MI 48105 (www.nsf.org)

¹ May also be obtained from American National Standards Institute (ANSI), 25 West 43rd Street, New York, NY 10036.

NONMANDATORY APPENDIX A QUALITY SYSTEM PROGRAM

The products manufactured in accordance with this Standard shall be produced under a quality system program following the principles of an appropriate standard from the ISO 9000 series.¹ A determination of the need for registration or certification, or both, of the product manufacturer's quality system program by an independent organization shall be the responsibility of the manufacturer. The detailed documentation demon-

strating program compliance shall be available to the purchaser at the manufacturer's facility. A written summarized description of the program utilized by the product manufacturer shall be available to the purchaser upon request. The product manufacturer is defined as the entity whose name or trademark appears on the product in accordance with the marking or identification requirements of this Standard.

¹The series is also available from the American National Standards Institute (ANSI) and the American Society for Quality (ASQ) as American National Standards that are identified by the prefix "Q," replacing the prefix "ISO." Each standard of the series is listed under References in [Mandatory Appendix I](#).

B16 AMERICAN NATIONAL STANDARDS FOR PIPING, PIPE FLANGES, FITTINGS, AND VALVES

B16.1-2020	Gray Iron Pipe Flanges and Flanged Fittings: Classes 25, 125, and 250
B16.3-2021	Malleable Iron Threaded Fittings: Classes 150 and 300
B16.4-2021	Gray Iron Threaded Fittings: Classes 125 and 250
B16.5-2020	Pipe Flanges and Flanged Fittings: NPS ½ Through NPS 24 Metric/Inch Standard
B16.9-2018	Factory-Made Wrought Butt welding Fittings
B16.10-2017	Face-to-Face and End-to-End Dimensions of Valves
B16.11-2016	Forged Fittings, Socket-Welding and Threaded
B16.12-2019	Cast Iron Threaded Drainage Fittings
B16.14-2018	Ferrous Pipe Plugs, Bushings, and Locknuts With Pipe Threads
B16.15-2018	Cast Copper Alloy Threaded Fittings
B16.18-2021	Cast Copper Alloy Solder Joint Pressure Fittings
B16.20-2017	Metallic Gaskets for Pipe Flanges
B16.21-2021	Nonmetallic Flat Gaskets for Pipe Flanges
B16.22-2021	Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings
B16.23-2021	Cast Copper Alloy Solder Joint Drainage Fittings: DWV
B16.24-2016	Cast Copper Alloy Pipe Flanges, Flanged Fittings, and Valves: Classes 150, 300, 600, 900, 1500, and 2500
B16.25-2017	Butt welding Ends
B16.26-2018	Cast Copper Alloy Fittings for Flared Copper Tubes
B16.29-2017	Wrought Copper and Wrought Copper Alloy Solder-Joint Drainage Fittings — DWV
B16.33-2012 (R2017)	Manually Operated Metallic Gas Valves for Use in Gas Piping Systems Up to 175 psi (Sizes NPS ½ Through NPS 2)
B16.34-2020	Valves — Flanged, Threaded, and Welding End
B16.36-2020	Orifice Flanges
B16.38-2012 (R2017)	Large Metallic Valves for Gas Distribution: Manually Operated, NPS 2½ (DN 65) to NPS 12 (DN 300), 125 psig (8.6 bar) Maximum
B16.39-2019	Malleable Iron Threaded Pipe Unions: Classes 150, 250, and 300
B16.40-2019	Manually Operated Thermoplastic Gas Shutoffs and Valves in Gas Distribution Systems
B16.42-2021	Ductile Iron Pipe Flanges and Flanged Fittings: Classes 150 and 300
B16.44-2012 (R2017)	Manually Operated Metallic Gas Valves for Use in Aboveground Piping Systems Up to 5 psi
B16.47-2020	Large Diameter Steel Flanges: NPS 26 Through NPS 60 Metric/Inch Standard
B16.48-2020	Line Blanks
B16.49-2017	Factory-Made, Wrought Steel, Butt welding Induction Bends for Transportation and Distribution Systems
B16.50-2021	Wrought Copper and Copper Alloy Braze-Joint Pressure Fittings
B16.51-2021	Copper and Copper Alloy Press-Connect Pressure Fittings
B16.52-2018	Forged Nonferrous Fittings, Socket-Welding and Threaded (Titanium, Titanium Alloys, Aluminum, and Aluminum Alloys)

The ASME Publications Catalog shows a complete list of all the Standards published by the Society. For a complimentary catalog, or the latest information about our publications, call 1-800-THE-ASME (1-800-843-2763).

ASME Services

ASME is committed to developing and delivering technical information. At ASME's Customer Care, we make every effort to answer your questions and expedite your orders. Our representatives are ready to assist you in the following areas:

ASME Press	Member Services & Benefits	Public Information
<i>Codes & Standards</i>	Other ASME Programs	Self-Study Courses
Credit Card Orders	Payment Inquiries	Shipping Information
IMEchE Publications	Professional Development	Subscriptions/Journals/Magazines
Meetings & Conferences	Short Courses	Symposia Volumes
Member Dues Status	Publications	Technical Papers

How can you reach us? It's easier than ever!

There are four options for making inquiries* or placing orders. Simply mail, phone, fax, or E-mail us and a Customer Care representative will handle your request.

<i>Mail</i>	<i>Call Toll Free</i>	<i>Fax—24 hours</i>	<i>E-Mail—24 hours</i>
ASME	US & Canada: 800-THE-ASME	973-882-1717	customer care@asme.org
150 Clove Road, 6th Floor	(800-843-2763)	973-882-5155	
Little Falls, New Jersey	Mexico: 95-800-THE-ASME		
07424-2139	(95-800-843-2763)		

*Customer Care staff are not permitted to answer inquiries about the technical content of this code or standard. Information as to whether or not technical inquiries are issued to this code or standard is shown on the copyright page. All technical inquiries must be submitted in writing to the staff secretary. Additional procedures for inquiries may be listed within.

ASME B16.51-2021

ISBN 978-0-7918-7495-0



9 780791 874950



J 1 8 4 2 Q